



# GUAM POWER AUTHORITY

ATURIDÁT ILEKTRESEDÁT GUÅHAN  
P.O.BOX 2977 • HAGÁTÑA, GUAM U.S.A. 96932-2977

February 19, 2026

AMENDMENT NO.: II

TO

INVITATION TO BID NO.: GPA-021-26

FOR

GENERATOR REPLACEMENT AT THE GUAM MEMORIAL  
HOSPITAL AUTHORITY

Prospective Bidders are hereby notified of the following change and response to an inquiry received from Bidder No. 8 dated February 11, 2026:

**CHANGE:**

1. **REMOVE** Page 16 of 138 and **REPLACE** with Page 16a of 138 (see attached).

- a. Under GENERATOR TECHNICAL REQUIREMENTS COMPLIANCE SECTION, No. 10, verbiage has changed

**FROM:**

The contractor will be responsible for ensuring the GMHA Generator room has enough floor and ceiling space and for all generators and equipment provided (i.e. generator maintenance spaces, spaces for exhaust piping or silencers) provided. The GMHA roll- up door entryway is 10ft high.

**\* TO NOW READ:**

The contractor will be responsible for ensuring the GMHA Generator room has enough floor and ceiling space and for all generators and equipment provided (i.e. generator maintenance spaces, spaces for exhaust piping or silencers) provided. The GMHA roll- up door entryway is 13ft high and 13ft wide.

- b. Under GENERATOR TECHNICAL REQUIREMENTS COMPLIANCE SECTION, No. 13, verbiage has changed

**FROM:**

Shall be auto-start capable and integrate with the new ATS system.

**\* TO NOW READ:**

Shall be auto-start capable and integrate with the new ATS system. If the Generator rating is 1.6 MW, then the ATS rating should typically be 2500 AMPS at minimum at 480V 4 pole. For the Generator rating 2 MW, ATS at minimum typically be at 3000 AMPS at 480V 4 pole.

- c. Under GENERATOR TECHNICAL REQUIREMENTS COMPLIANCE SECTION, No. 22, verbiage has changed

**FROM:**

Shall include new fuel day tanks with pump and float switch.

**\* TO NOW READ:**

Shall include new fuel day tanks with pump and float switch. New fuel day tanks be at least 400 gallons not to exceed 660 gallons for NFPA 110 requirements. The day tanks will be connected to the larger, underground fuel tank at the hospital with the new fuel line work that was mentioned in the bid document.

2. **REMOVE** Page 88 of 138 and **REPLACE** with Page 88a of 138 (see attached).

Under GENERAL CONDITIONS, 3. BIDS, BIDDER RESPONSIBILITIES:

**OMIT** letter b) Submission of Bids, *No.1*), *The bidder is required to bid on all items called for in the Bid Form.*

**Section b) Submission of Bids shall now read:**

- 1) Bids shall be submitted on the forms furnished or copies thereof, and shall be signed in ink. Erasures or other changes in a bid must be explained or noted over the signature of the bidder. Bids containing any conditions, omissions, unexplained erasures or alterations or items not called for in the proposal or irregularities of any kind may be rejected by the Owner as being incomplete.
- 2) Each bid must give the full business address of the bidder and be signed by him with his usual signature. Bids by partnerships must furnish the full names of all partners and must be signed in the name of the partnership by one of the members of the partnership or by an authorized representative followed by the signature and designation of the person signing. Bids by corporations must be signed with the legal name of the corporation, followed by the name of the State of incorporation and by the signature and designation of the president, secretary, or other person authorized to bind it in the matter. The name of each person signing shall also be typed or printed below the signature. A bid by a person who affixes to his signature the word "president", (agent or other designation, without disclosing his principal), may be held to the bid. When requested by the Owner, satisfactory evidence of the authority of the officer signing in behalf of the corporation shall be furnished.

**RESPONSE:**

**QUESTION:**

1. Page 16 of 138, #10 – How wide is the roll-up door?

Please refer to the above CHANGE No. 1.a. The GMHA roll-up door entryway is 13 ft. high and 13 ft. wide.

**QUESTION:**

2. Page 16 of 138, #13 - Please provide specs on the New ATS system, so we can determine what is needed on the generator side for connection.


**ANSWER:**

Please refer to the above CHANGE No. 1.b. If the Generator rating is 1.6 MW, then the ATS rating should typically be 2500 AMPS at minimum at 480V 4 pole.

For the Generator rating 2 MW, ATS at minimum typically be at 3000 AMPS at 480V 4 pole.  
Please see current ATS model numbers below:


ATS #4



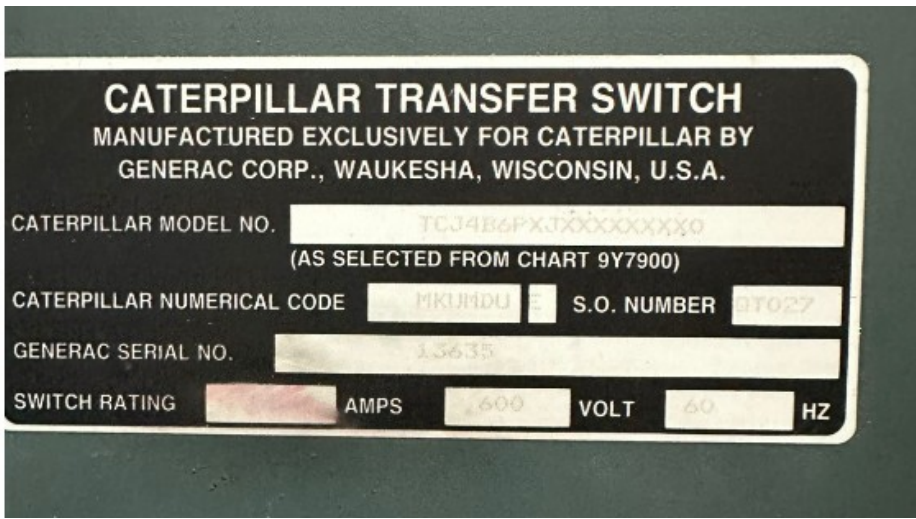


ATS #2



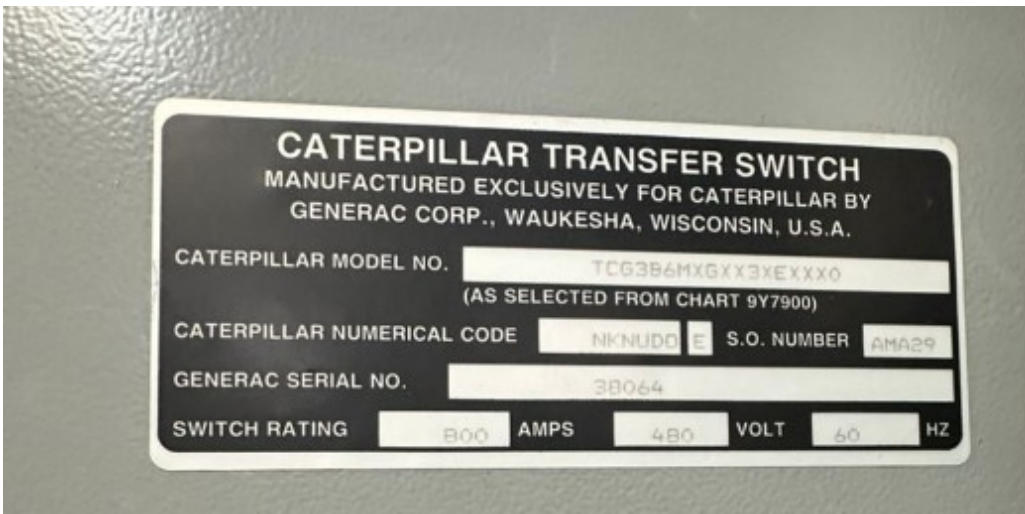

ATS#1

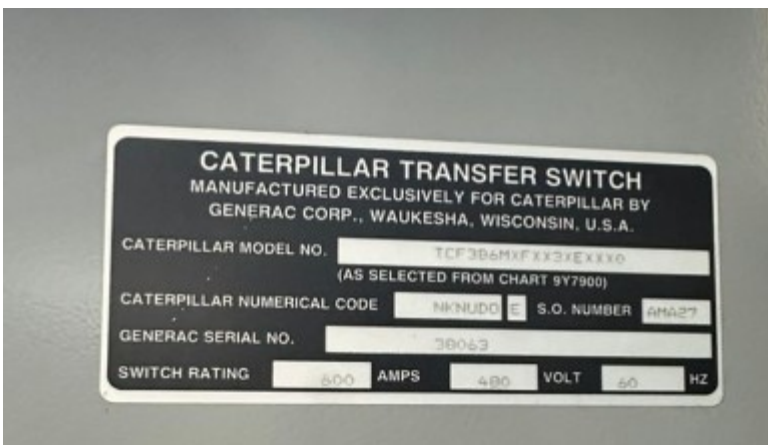

**QUESTION:**

3. Page 16 of 138, #22 – What is minimum capacity of new fuel day tanks?

**ANSWER:**

Please refer to the above CHANGE No. 1.c. New fuel day tanks be at least 400 gallons not to exceed 660 gallons for NFPA 110 requirements. The day tanks will be connected to the larger, underground fuel tank at the hospital with the new fuel line work that was mentioned in the bid

**QUESTION:**

4. Page 88 of 138, 2b – Bidder required to bid on all items (see page 132 #7).

**ANSWER:**

Please refer to the above CHANGE No. 1, 2b has been omitted from this section.

**QUESTION:**

5. Page 132, #7, ALL or None "Bid" not X). Please advise.

**ANSWER:**

Please refer to the above CHANGE No. 2. This requirement is not an "All or None" bid.

All other Terms and Conditions in the bid package shall remain unchanged and in full force.



JOHN M. BENAVENTE, P.E.

General Manager

